



GRADES LESS THAN 8%

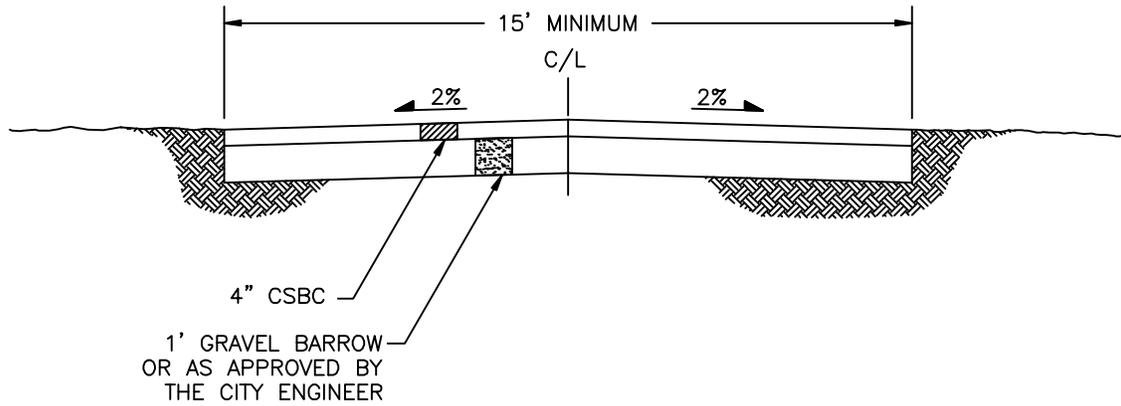

GRADES 8% AND OVER

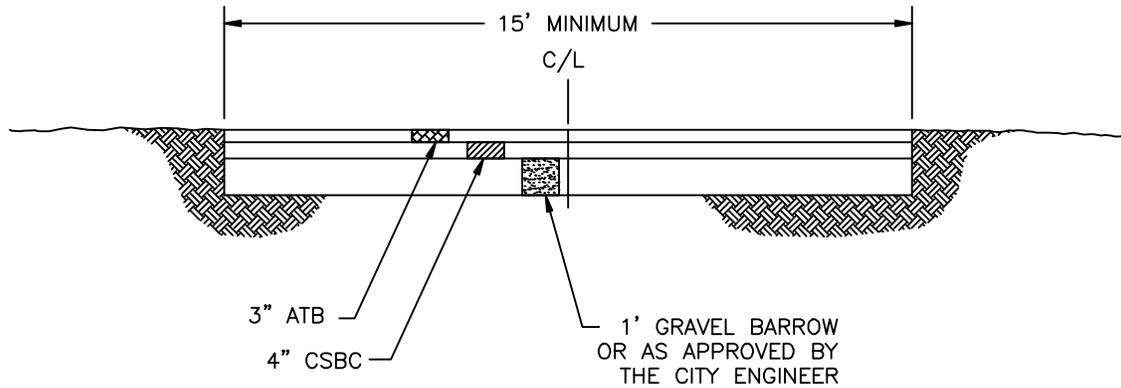

NOTES:

1. COMPACTION TESTS ARE REQUIRED. THE NUMBER OF TESTS TO BE FIELD DETERMINED BY THE CITY INSPECTOR. ALL TESTING SHALL BE PERFORMED BY A LICENSED TESTING LABORATORY. MINIMUM COMPACTION SHALL BE 95% MAXIMUM DENSITY OF BOTH SUBGRADE AND CSBC.
2. GRADES 8% AND OVER REQUIRE 3" ATB. COMPACTION SHALL BE AN AVERAGE OF 92% OF DRY DENSITY.



APPROVED BY	L. OLIVE
DATE	07/31/2008
REF STD SPEC	

DEPARTMENT OF PUBLIC WORKS
STANDARD DETAILS
ALL WEATHER SURFACES FOR
UTILITY ACCESS

STANDARD DETAIL
NUMBER
R-050