


NORTH OR EAST
SIDE OF STREET

SOUTH OR WEST
SIDE OF STREET

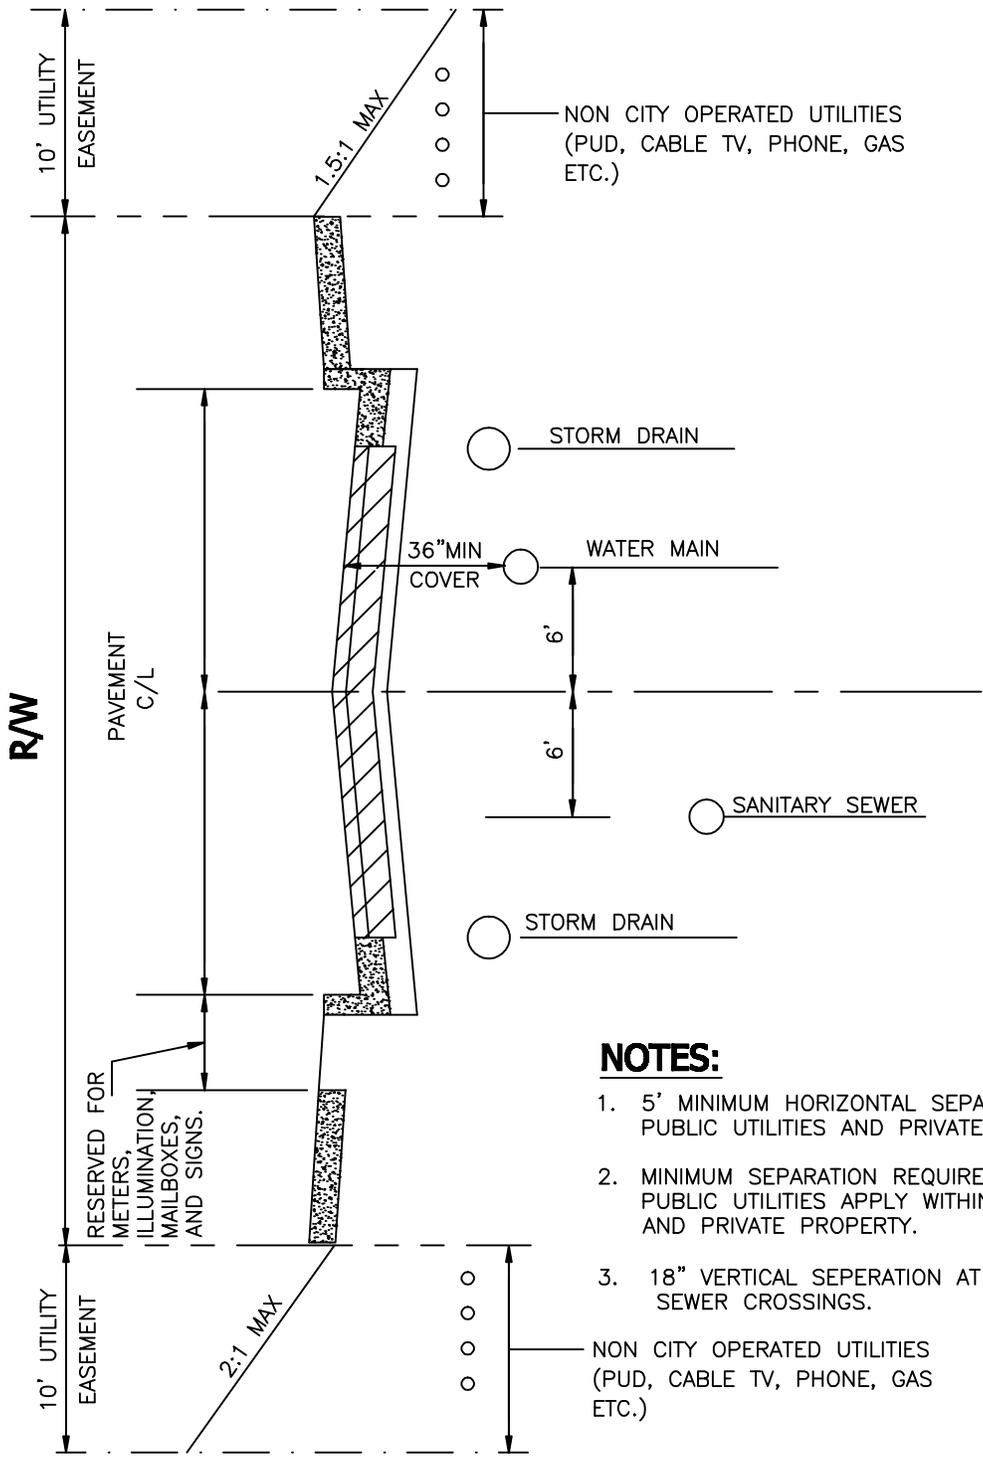

NOTES:

1. 5' MINIMUM HORIZONTAL SEPARATION BETWEEN PUBLIC UTILITIES AND PRIVATE UTILITIES.
2. MINIMUM SEPARATION REQUIREMENTS FROM PUBLIC UTILITIES APPLY WITHIN EASEMENTS AND PRIVATE PROPERTY.
3. 18" VERTICAL SEPERATION AT WATER AND SEWER CROSSINGS.



APPROVED BY	L. OLIVE
DATE	07/31/2008
REF STD SPEC	

DEPARTMENT OF PUBLIC WORKS
STANDARD DETAILS

TYPICAL UTILITY LOCATIONS

STANDARD DETAIL
NUMBER

R-060