


PLAN VIEWS

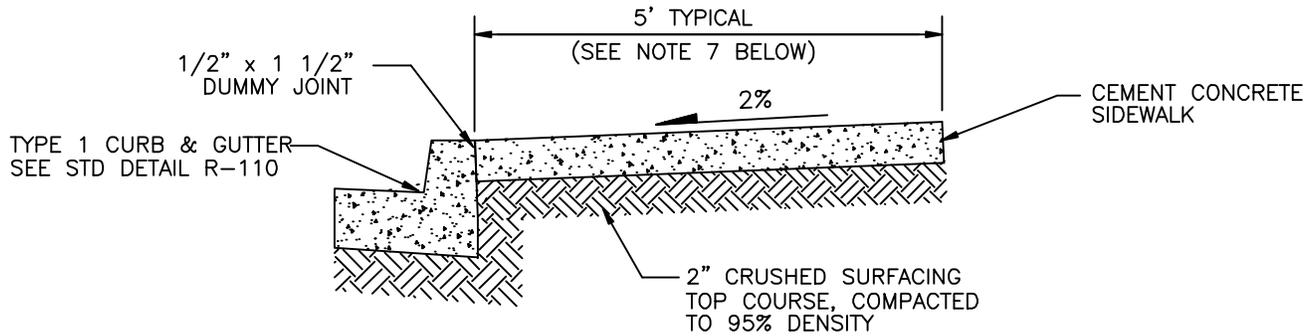

TYPICAL SECTION

NOTES:

1. SIDEWALKS SHALL BE A MINIMUM OF 4" THICK, AND SHALL BE CLASS 3000 CEMENT CONCRETE, WITH AIR ENTRAINMENT (MIN 4.5% - MAX 6.5%).
2. FULL EXPANSION JOINTS SHALL GENERALLY BE PLACED TO MATCH THOSE PLACED IN ADJACENT CURB & GUTTER, WITH MAXIMUM SPACING OF 30 FEET, FINAL SPACING DETERMINATION SHALL BE DECIDED BY THE INSPECTOR IN THE FIELD.
3. SUBGRADE SHALL BE COMPACTED TO NOT LESS THAN 95% OF MAXIMUM DENSITY.
4. SIDEWALK SHALL BE AT LEAST 6" THICK IN DRIVEWAYS.
5. THE FINISHED SIDEWALK SHALL BE SPRAYED WITH A TRANSPARENT CURING COMPOUND COVERED BY WATERPROOF PAPER OR PLASTIC SHEETING IN THE EVENT OF RAIN OR OTHER INCLEMENT WEATHER. CURING TIME SHALL BE FOR A MINIMUM OF 72 HOURS.
6. ALL JOINTS SHALL BE CLEANED AND EDGED WITH AN EDGER HAVING A 1/4" RADIUS.
7. SIDEWALKS ARE TYPICALLY 5' WIDE, WIDER SIDEWALK MAY BE REQUIRED BY THE CITY.



APPROVED BY	L. OLIVE
DATE	07/31/2008
REF STD SPEC	

DEPARTMENT OF PUBLIC WORKS STANDARD DETAILS
CEMENT CONCRETE SIDEWALK

STANDARD DETAIL NUMBER
R-170