




PLAN

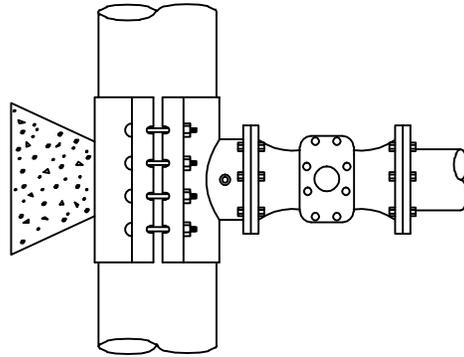

PLAN

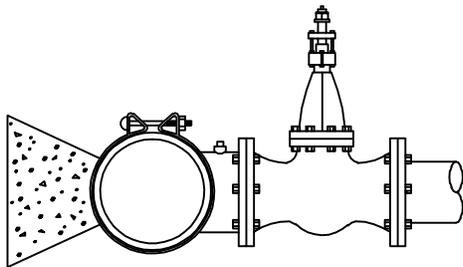

ELEVATION

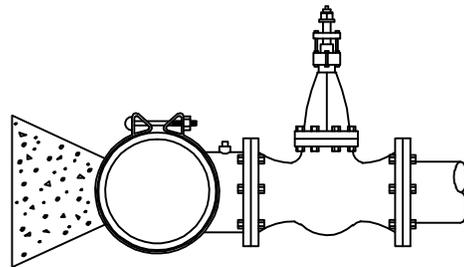

ELEVATION

**STEEL FABRICATED EPOXY
COATED TAPPING SLEEVE**

INSTALLED ON DI PIPE

**FABRICATED STAINLESS STEEL
TAPPING SLEEVE**

INSTALLED ON AC PIPE

NOTES:

1. STAINLESS STEEL TAPPING TEES SHALL HAVE FULL CIRCLE SEAL.
2. STEEL TAPPING TEES SHALL BE EPOXY COATED.
3. ALL TEES AND VALVES TO BE WATER TESTED BEFORE TAPPING.



| | |
|---------------|------------|
| APPROVED BY | L. OLIVE |
| DATE | 07/31/2008 |
| REF STAD SPEC | |
| | |

DEPARTMENT OF PUBLIC WORKS
STANDARD DETAILS

TAPPING SLEEVES

STANDARD DETAIL
NUMBER

W-200