

Snohomish County PUD Battery Energy Storage
Neighborhood Meeting

The neighborhood meeting was scheduled for Tuesday, March 25, 2025 at 5:00 pm. City staff prepared a presentation to show a summary overview of the project. The Teams meeting was opened at 4:56 pm. The following participants were in attendance for the meeting:

Snohomish County PUD Staff – Property Owner

Garrison Marr
Colleen Murphy
Scott Gibson
Jessica Spahr
Alex Chorey

Ameresco Staff – Project Applicant

Scott Wentworth
Patrick Shoop
Jessica Georgescu

There were no public participants outside of the applicant or the property owner. The meeting was closed at 5:22 pm.

Snohomish County PUD Battery Energy Storage System Neighborhood Meeting

March 25, 2025

CITY OF ARLINGTON




Project Description:

- 25-megawatt Battery Energy Storage System
- Battery footprint is approximately 1.5 acres of a 12.39-acre parcel, with the overall PUD Campus of 25.69 acres.
- The utility scale battery energy storage system will provide stored electrical energy for the Snohomish County PUD to use as additional capacity to the Arlington electrical grid.
- The BESS system is comprised of 38 Tesla Megapack 2XL batteries with 12 associated transformers, an auxiliary transformer, and a Power Control House.





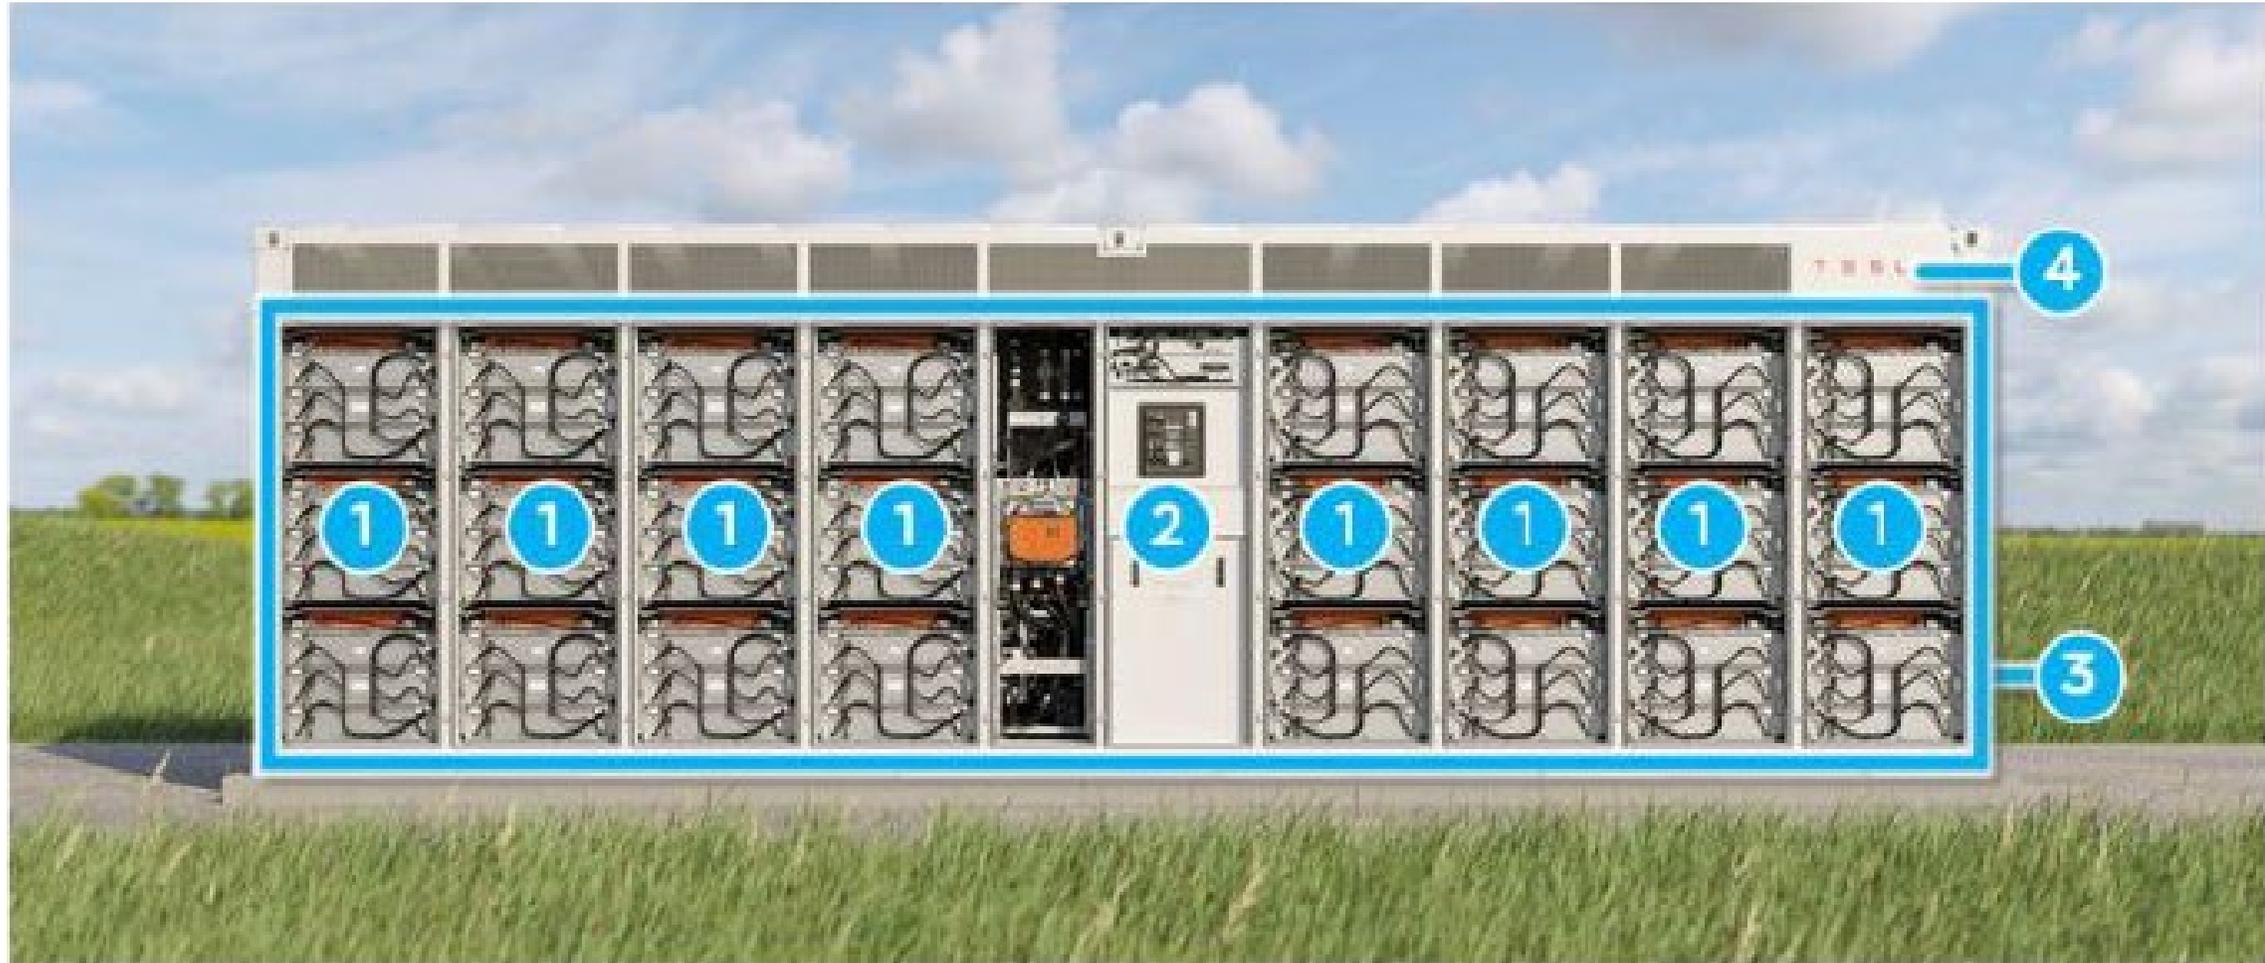

1. Battery modules with active and passive fuses – externally serviceable
2. Touch-safe customer Interface Bay
3. Non-walk-in IP66 enclosure and deflagration mitigation
4. Thermal roof with overpressure vents

Permit Process:

Requires a Conditional Use Permit that is approved by the Hearing Examiner

The proposal is required to meet the Arlington Municipal Code and sections specifically for Battery Energy Storage Systems

Required Noticing:

- Notice of Application
- Notice of SEPA MDNS Decision
- Notice of Neighborhood Meeting
- Notice of Public Hearing

