


TYPICAL NOTES:

- 1)-ALL EXPOSED PIPING AND FITTINGS TO BE GALVANIZED WITH THE EXCEPTION OF STORZ CONNECTION; SIZE PER PLANS
- 2)-6' TO 10' MAX. FROM FDC TO FIRE APPARATUS ACCESS (DRIVEWAY)
- 3)-FDC TO BE WITHIN 50' OF FIRE HYDRANT
- 4)-FDC TO BE ON SAME SIDE OF FIRE APPARATUS ACCESS (DRIVEWAY) AS FIRE HYDRANT

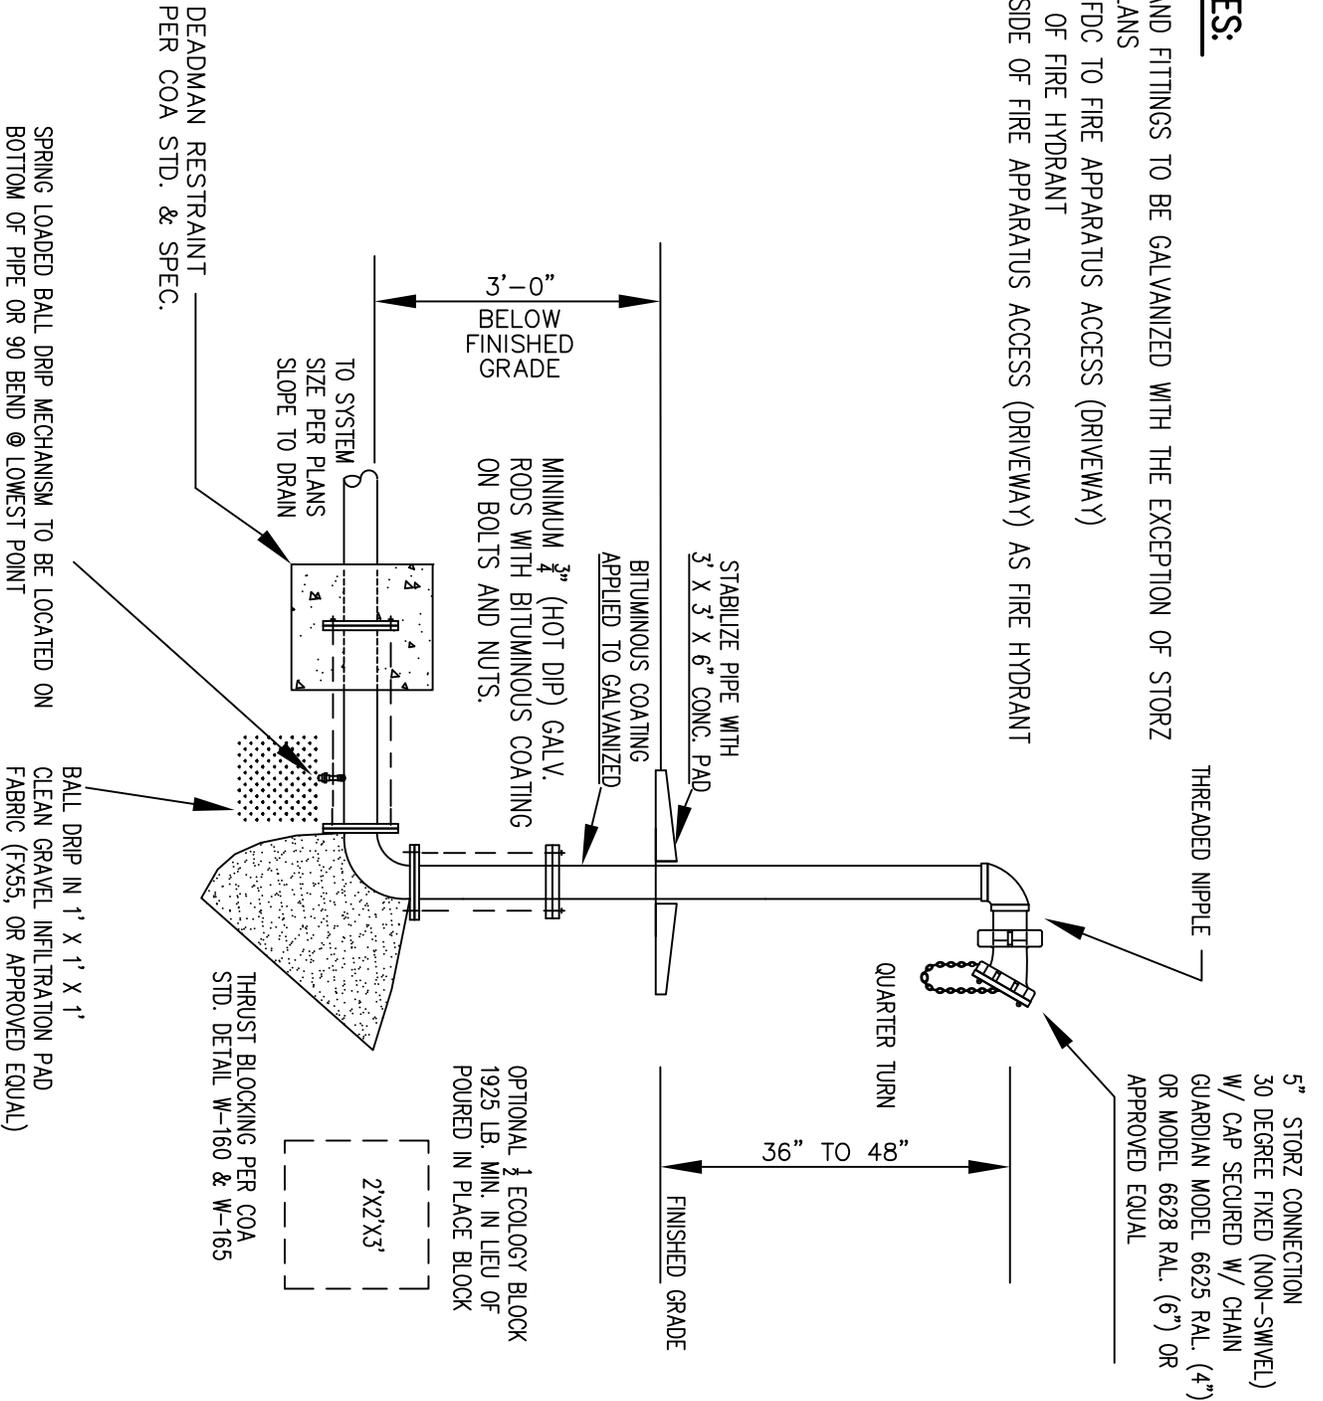

APPROVED BY	R. MORRISON
DATE	9/9/2020
REF STD SPEC	

DEPARTMENT OF PUBLIC WORKS
STANDARD DETAILS
 FIRE DEPARTMENT CONNECTION (FDC)
 DETAIL

STANDARD DETAIL NUMBER
W-225A